



Property/Easement Line

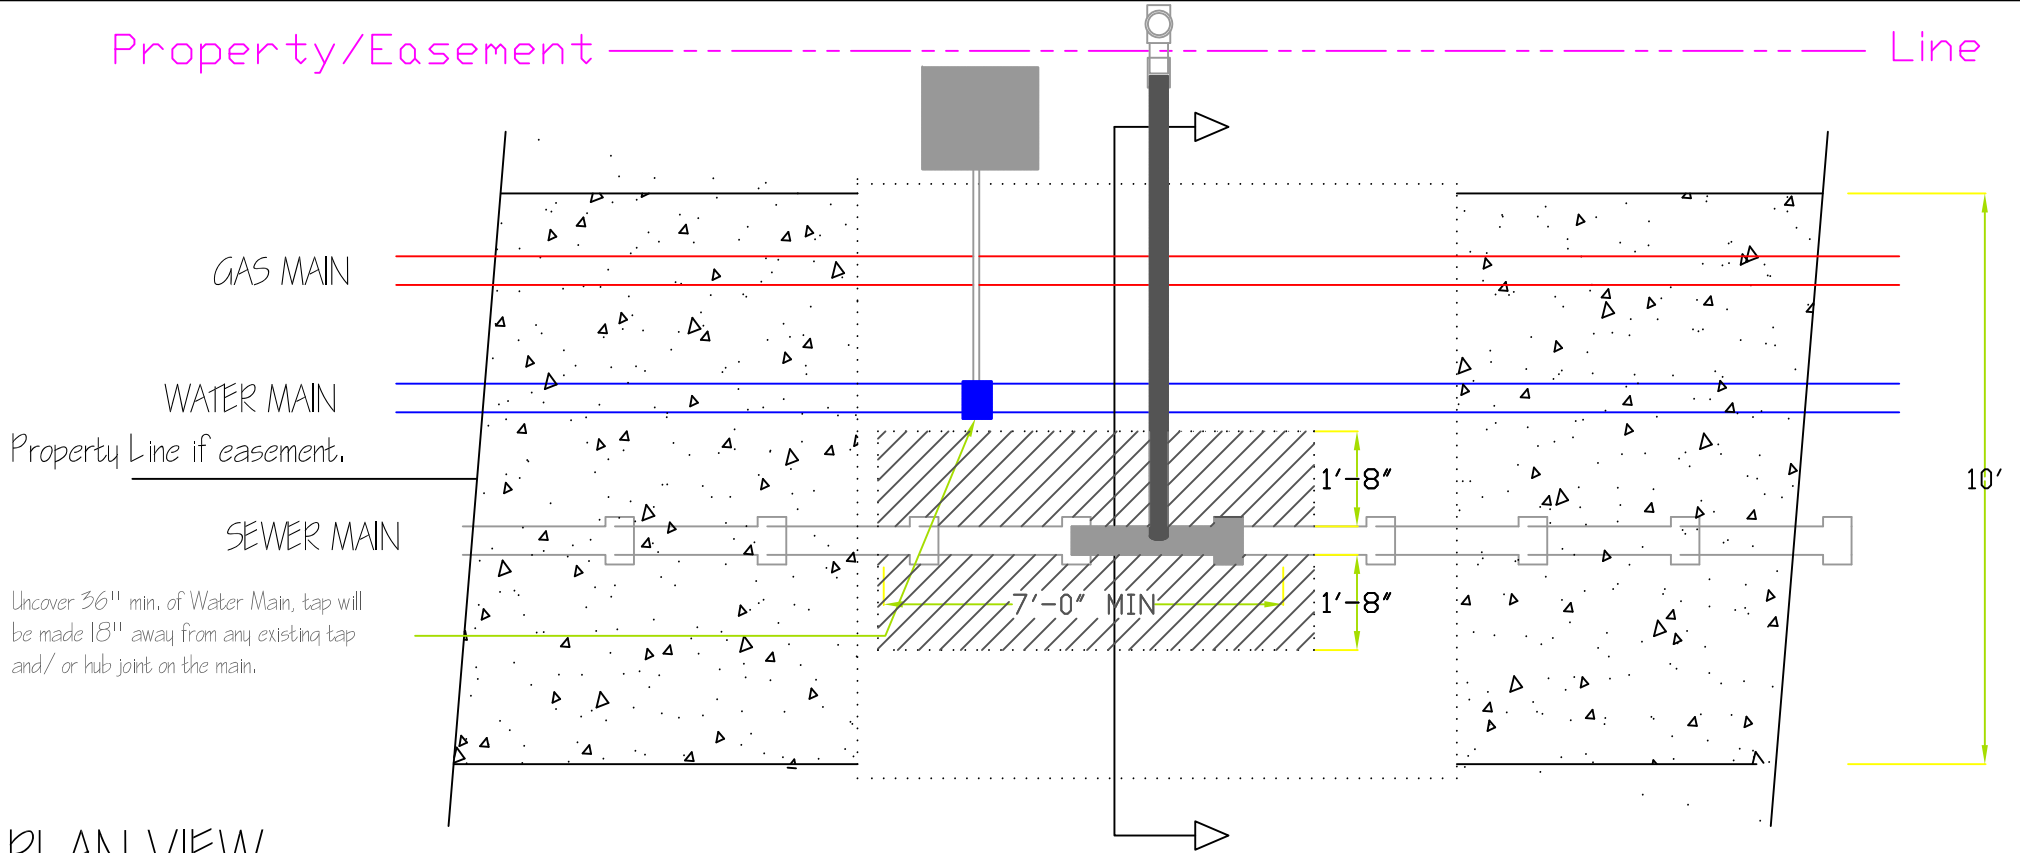

PLAN VIEW

Property/Easement Line

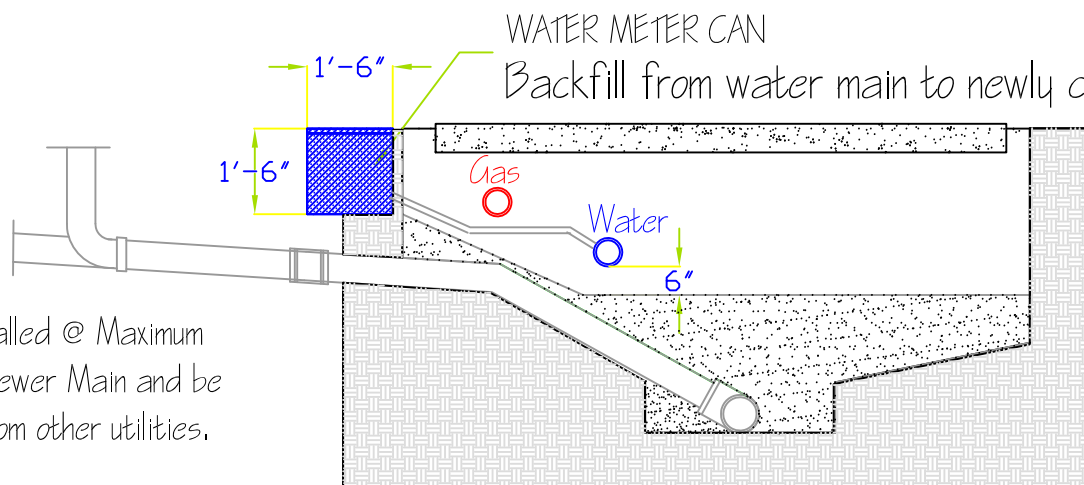

NOTE:

Sewer shall be installed @ Maximum of 45 degrees to Sewer Main and be located 8" away from other utilities.

150 p.s.i. Flowable Backfill is required under paved alley and street.

Shoring required per OSHA specifications if excavation is 5ft or more deep.

ALLEY SHALL BE RESTORED WITHIN FIVE (5) DAYS USING "HIGH EARLY STRENGTH (HES)" CONCRETE CURING TO 3500 PSI MINIMUM IN 24 HRS. (High Early Strength) IN 24HRS MINIMUM.

SECTION

SPECIFICATIONS FOR UTILITY EXCAVATION